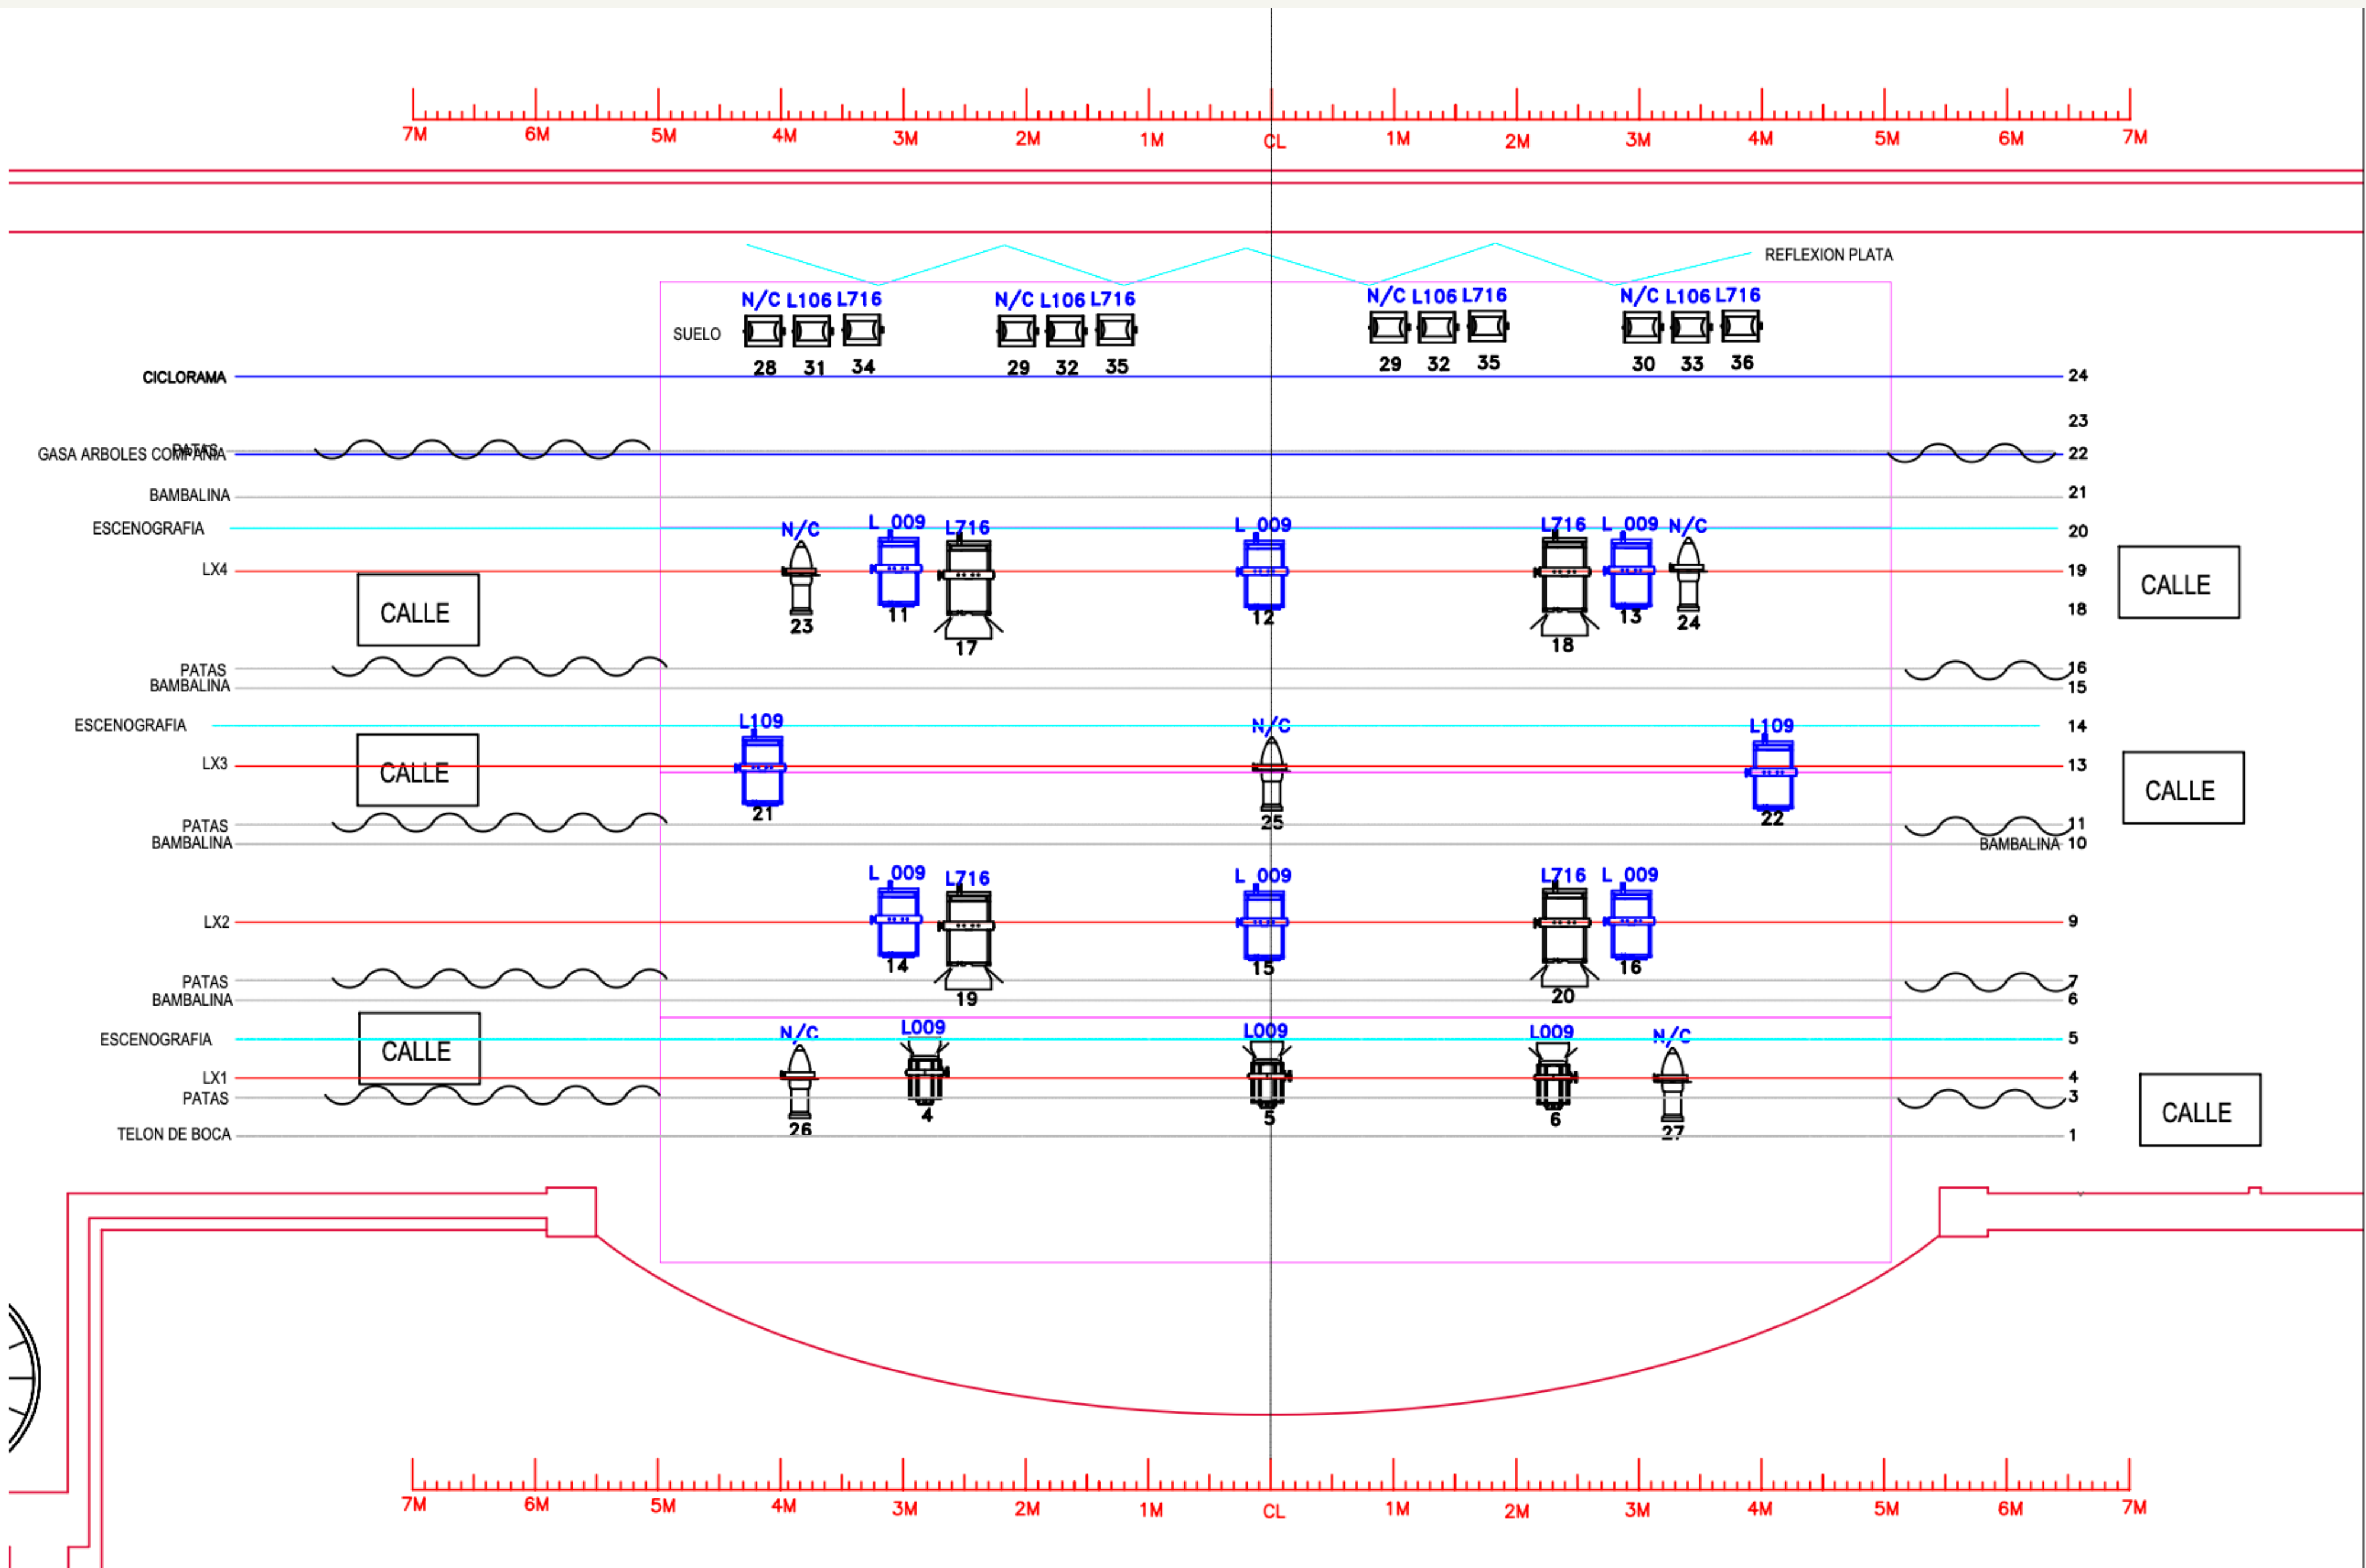
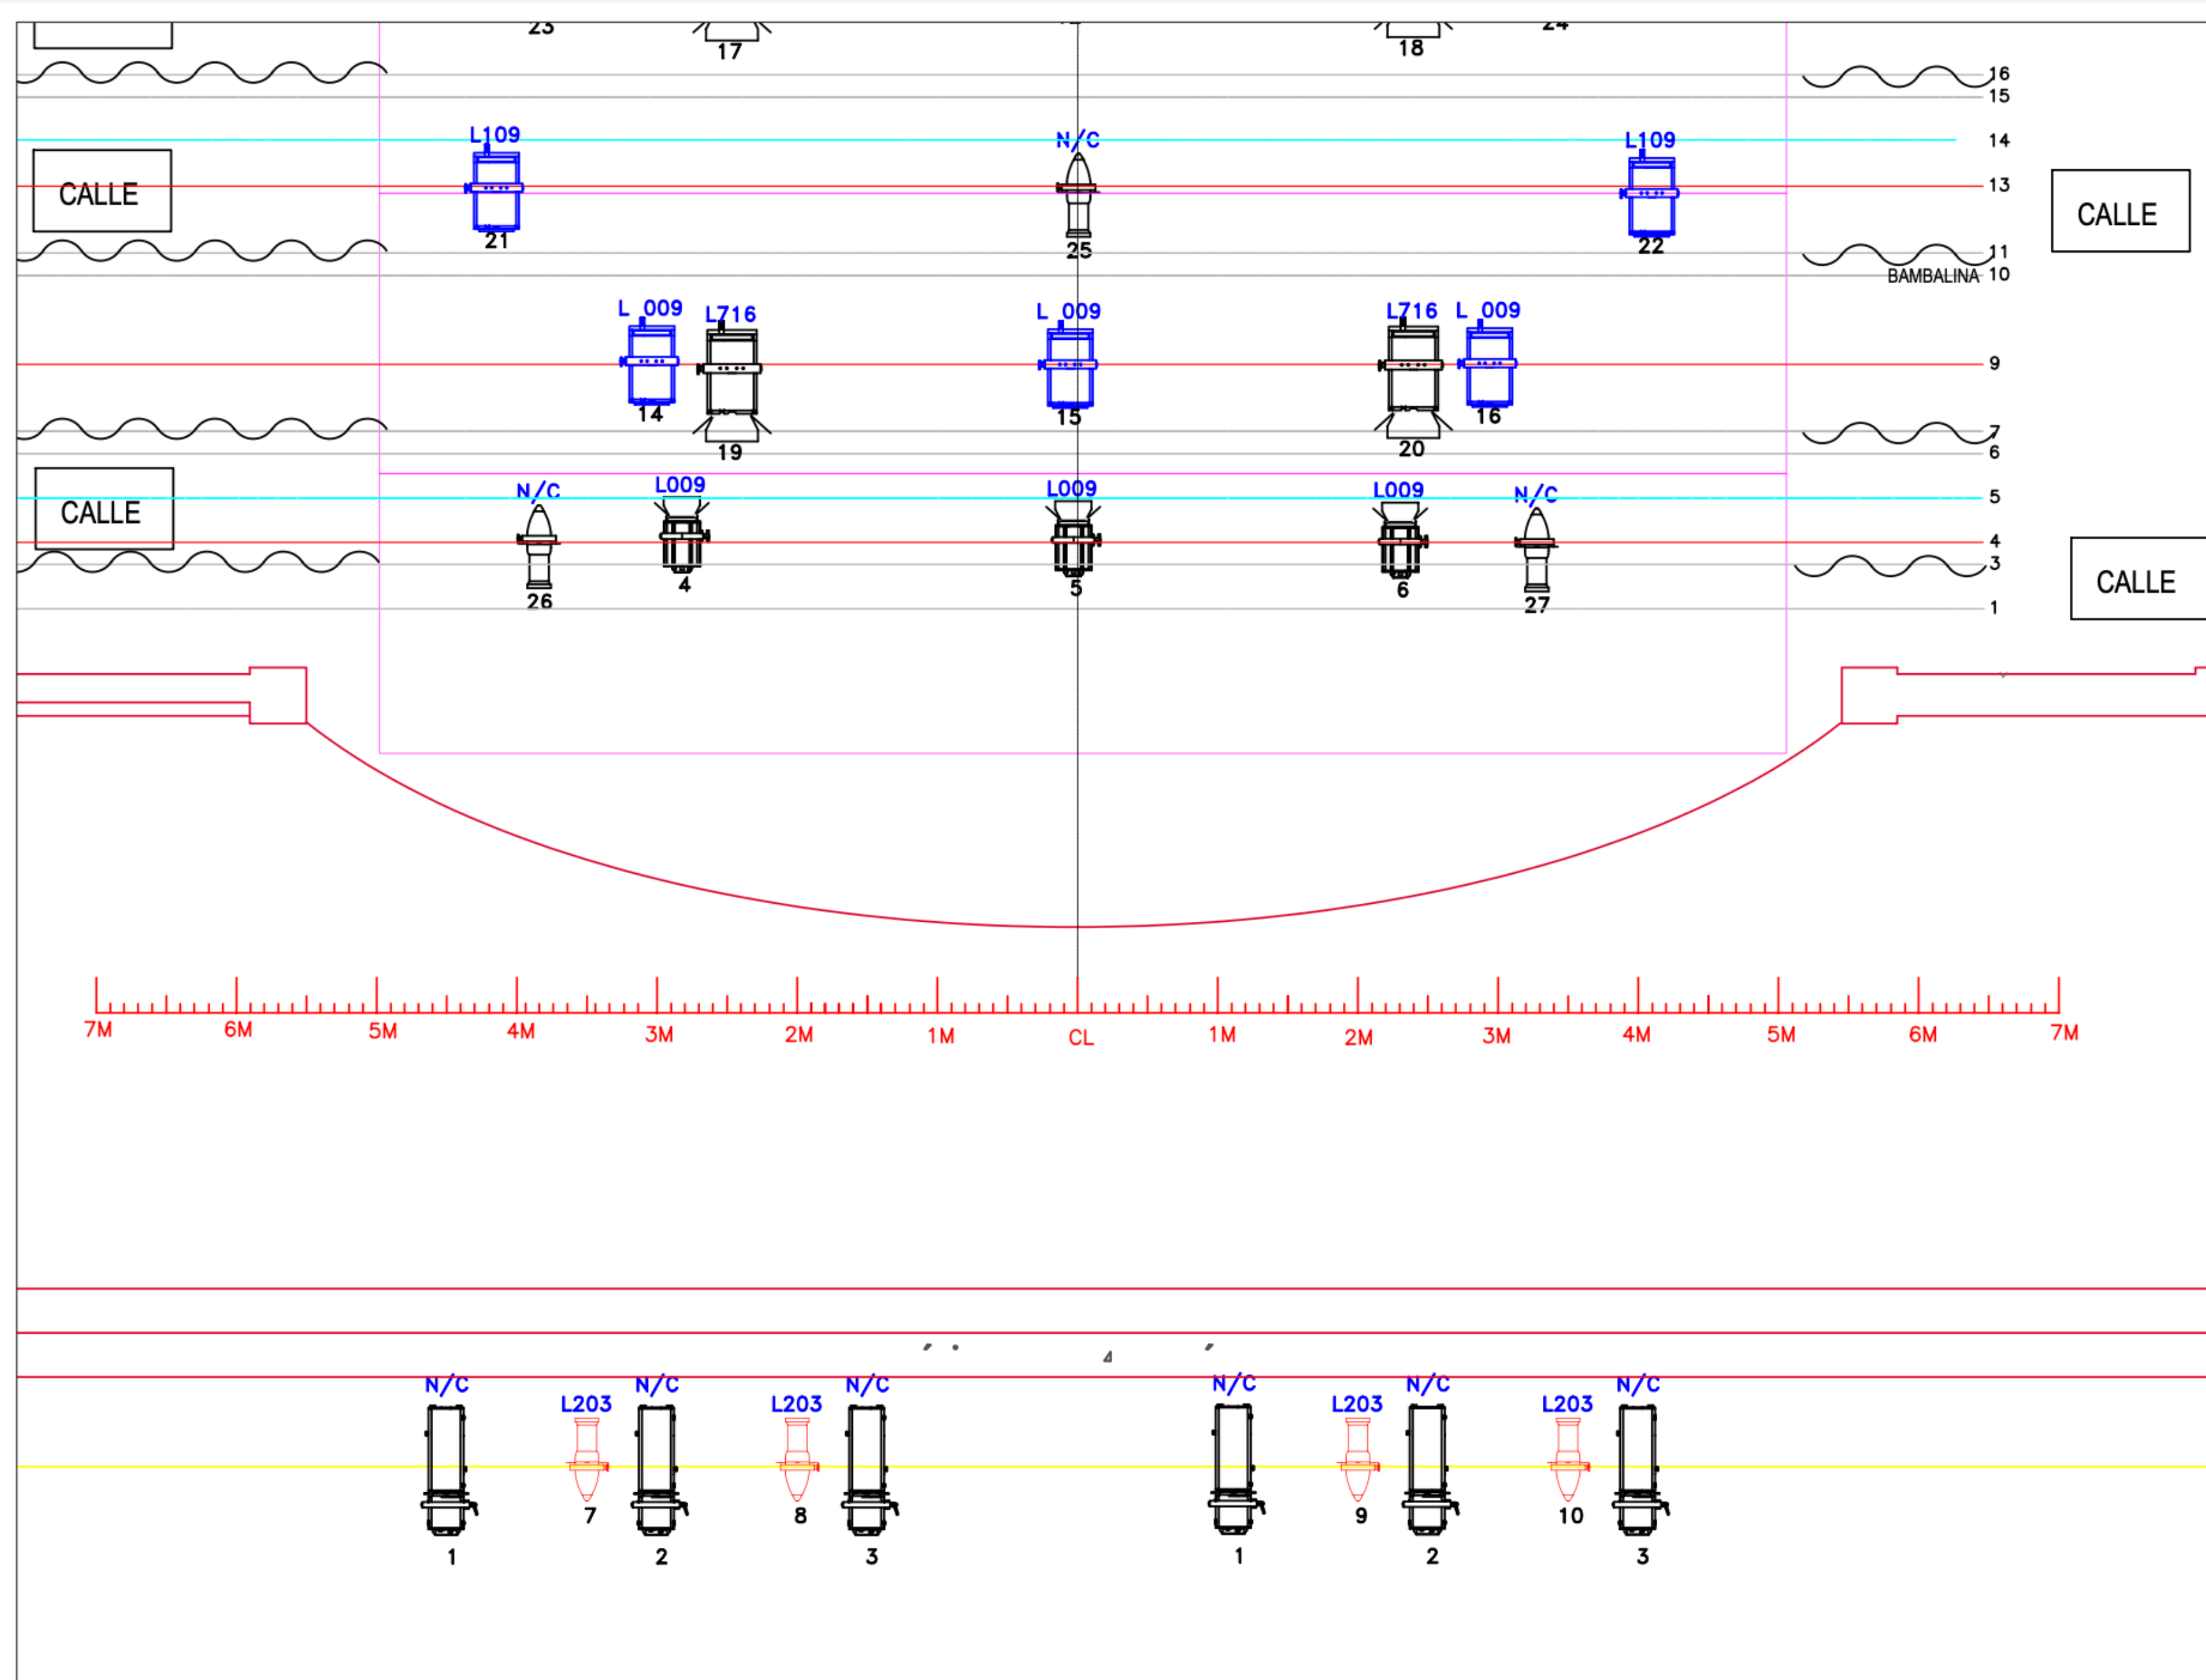


	PC 2 KW		8
	FRESNEL 2 KW		4
	PC 1KW		3
	PAR64 220V CP62		18
	RECORTE CANTATA 1 KW		6
	RECORTE ETC 25/50°		11
	RECORTE ETC 36°		10
	PANORAMA ASIM 1 KW		12







3,0 M 2,5 M 2,0 M 1,2 M



3,0 M 2,5 M 2,0 M 1,2 M



3,0 M 2,5 M 2,0 M 1,2 M




1,2 M 2 M 2,5 M 3,0 M

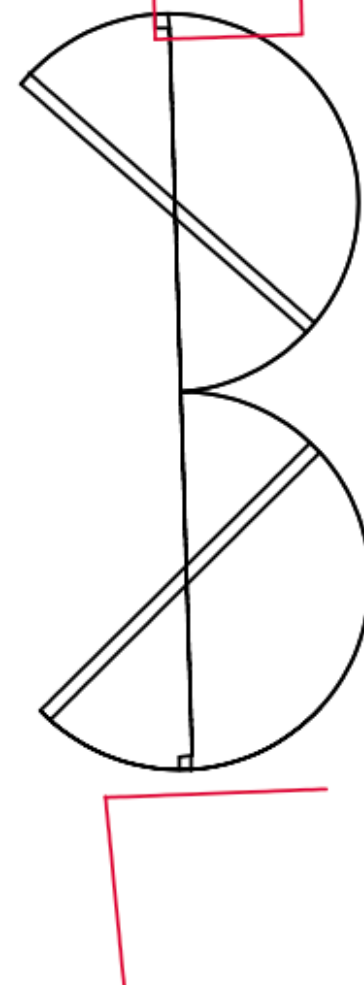
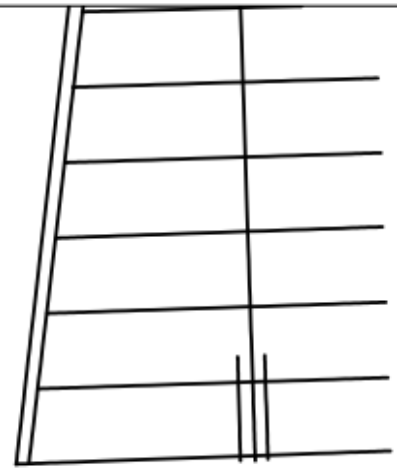










1,2 M 2 M 2,5 M 3,0 M



1,2 M 2 M 2,5 M 3,0 M

	PC 2 KW		8
---	---------	--	---



	PC 2 KW		8
	FRESNEL 2 KW		4
	PC 1KW		3
	PAR64 220V CP62		18
	RECORTE CANTATA 1 KW		6
	RECORTE ETC 25/50°		11
	RECORTE ETC 36°		10
	PANORAMA ASIM 1 KW		12